
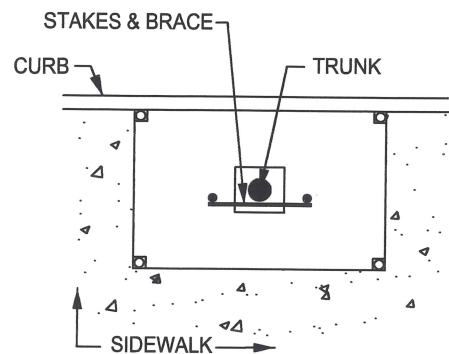


PLANTING AND STAKING

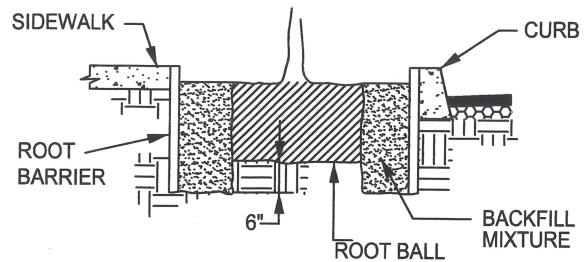

TREE WELL

NOTES:

1. Species shall be as approved by City's Forestry Master Plan.
2. All trees shall be of good health with a sound root system and straight, single trunk.
3. Minimum tree size shall be 24" box size container, with a 3/4" trunk caliper and 6' height. Where trees are located within sight distance areas per Plate 3-10, minimum canopy clearance shall be 8'.
4. Contact City Landscape Inspector at (805) 449-2499 for approval of locations, quality of plant material and installation.
5. Surface size of tree wells are to be 4' x 8' minimum unless American Disabilities Act (ADA) requirements necessitate a smaller opening.
6. Excavate planting pit width twice the size of the root ball, or equal to well, whichever is larger.
7. Install 1.5' x 8' root barrier panel(s) adjacent to sidewalk wherever tree is 6' or closer.
8. Amended backfill shall equal 2/3 excavated soil and 1/3 "approved" soil amendment. Backfill entire plant pit/tree well with amended soil. Thoroughly tamp backfill to eliminate air pockets.
9. Trees in lawn or residential front yards shall have a trunk protector installed at ground level, to prevent damage to bark and cambium.
10. All trees shall be planted within the City Right-of-Way or Public Service Easement.
11. See Plate No. 1-10 for additional street tree planting requirements.
12. Root ball should be free of girdling roots.

7	Minor Updates per FMP	1-31-17	NH
6	Modified Remove Brick per MSC	3-27-12	MAF
CHG	DESCRIPTION	DATE	INITIAL

CITY OF THOUSAND OAKS
PUBLIC WORKS DEPARTMENT

STANDARD
TREE PLANTING AND
STAKING DETAIL

PLATE NO.

8-17

APPROVED

CITY ENGINEER

DATE

1/27/17