


UTILITY	MIN. COVER	
	W/IN STREET, OR EASEMENT	BEHIND C&G, SIDEWALK
* C.T.V.	30"	16"
* Gas	30"	16"
Sanitary Sewer	7'+	N/A
* S.C.E.	36" to 48"	24"
Storm Drain	36"	N/A
* Tel.	30"	16"
Water	36" to 48"	N/A

* Both sides at Engineer's option

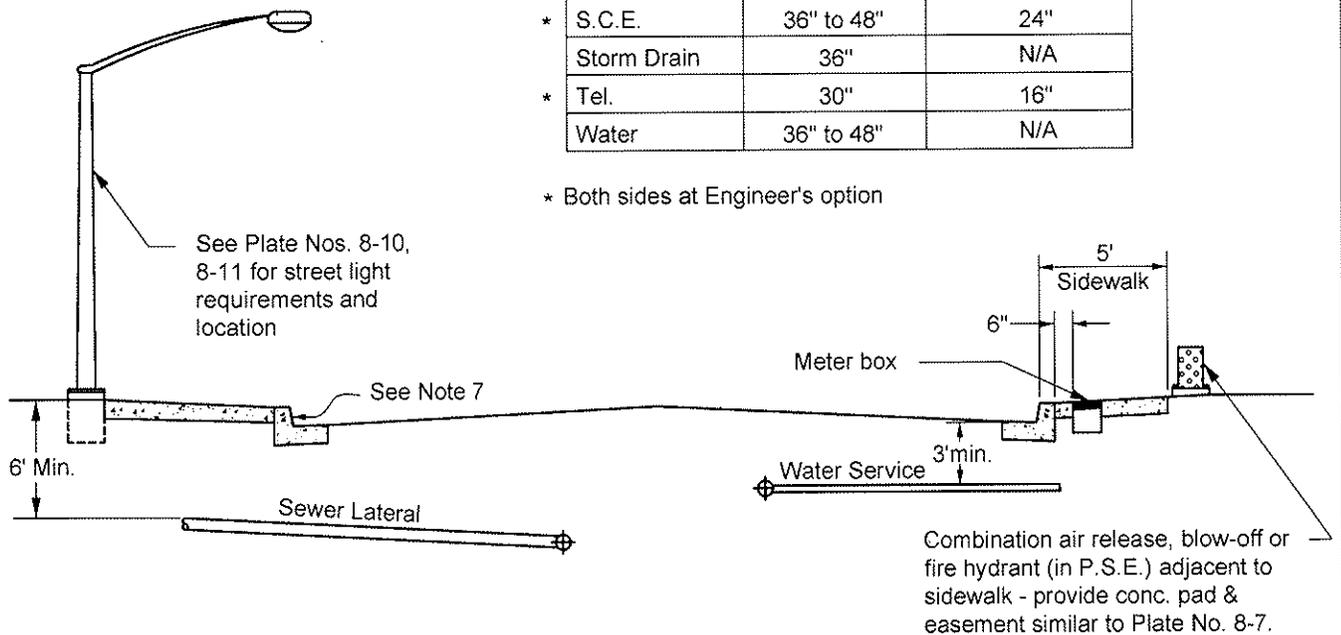

NOTES:

- Sanitary sewer to be 5' south or east of street center line, or as required to meet 4' min clearance to storm drain.
- Water to be 5' north or west of street center line, or as required to meet 4' min clearance to storm drain.
- All electrical utilities may be placed in common trench.
- Each respective utility should be consulted for any special requirements due to unique field and design conditions. Vaults, J-boxes, pedestals, etc. shall be located at property lines.
- A utility shall not reduce the required 4' min. width of accessible pathway for the physically handicapped. If needed, provide sidewalk extension similar to Plate Nos. 8-8 or 8-9.
- No utilities in median unless approved by City Engineer.
- Engrave 2" high letter "S" in curb face at location of sewer lateral.
- Street tree planting to conform to Plate Nos. 1-10 & 8-17.

5	Clarify Minimum Cover Requirements	10-22-08	MAF
3	Clarify Street Lighting Location	3-22-04	JTS
CHG	DESCRIPTION	DATE	INITIAL
APPROVED	<i>Jay D. Morgan</i> CITY ENGINEER	10/23/08 DATE	

CITY OF THOUSAND OAKS
PUBLIC WORKS DEPARTMENT

STANDARD
PLACEMENT OF UTILITIES
WITHIN STREET R/W

PLATE NO.
8-5