



F.H. AT BEGINNING OF CURB RETURN

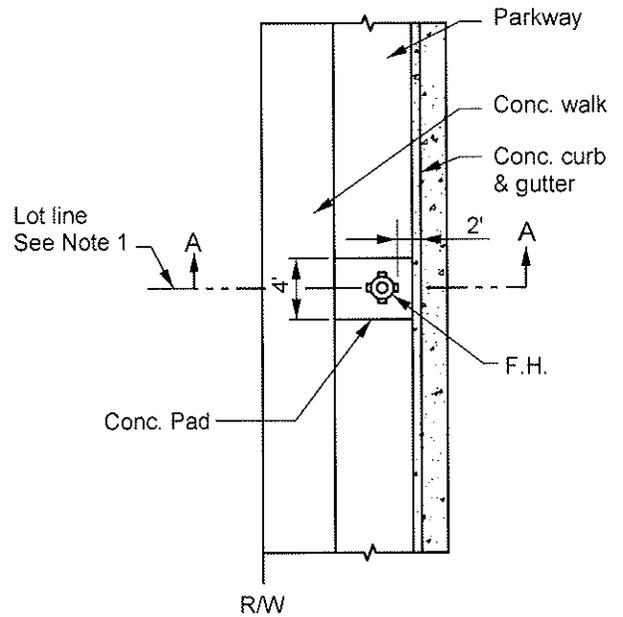

F.H. ALONG STREET

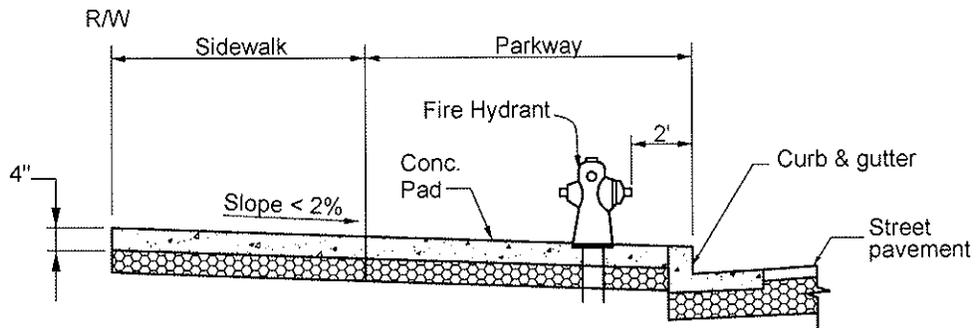

SECTION A-A

NOTE:

1. The precise location of F.H. relative to the lot line or the B.C. offset may be shifted up to 5' to avoid conflict with street lights, mail boxes or driveway approaches (provide 4' clearance from these improvements)
2. Location of F.H. must be approved by Ventura County Fire Protection District.
3. See City of Thousand Oaks Water Design Standards for additional location requirements.

				<b>CITY OF THOUSAND OAKS</b> PUBLIC WORKS DEPARTMENT	
5	Add Concrete Pad	10-22-08	MAP		
CHG	DESCRIPTION	DATE	INITIAL		
APPROVED	<i>Jay A. Morgan</i> CITY ENGINEER	10/23/08 DATE		STANDARD LOCATION OF FIRE HYDRANT IN DETACHED SIDEWALK AREAS	PLATE NO. <b>8-6</b>