


CONCRETE BLOCK GARDEN WALL



General Notes:

1. Concrete in footings to test 2500 psi at 28 days. 7-1/2 gal. per sack.
2. Footings shall be level. If ground slopes, step footings with each step equal to height of block used.
3. Mortar shall be 1 part cement, 1/2 part lime putty, and 4 1/2 part sand.
4. Cells containing reinforcement shall be filled solidly with grout. Grout shall be 1 part cement, 3 parts sand, and 2 parts gravel.
5. Concrete blocks shall be grade "A" units.
6. Footings of walls shall have a minimum setback of 5 ft. from the toe of any upslope.
7. Walls shall be centered on footings.
8. ATTENTION: This design is NOT to be used for retaining walls. See Building Division standards for retaining walls.

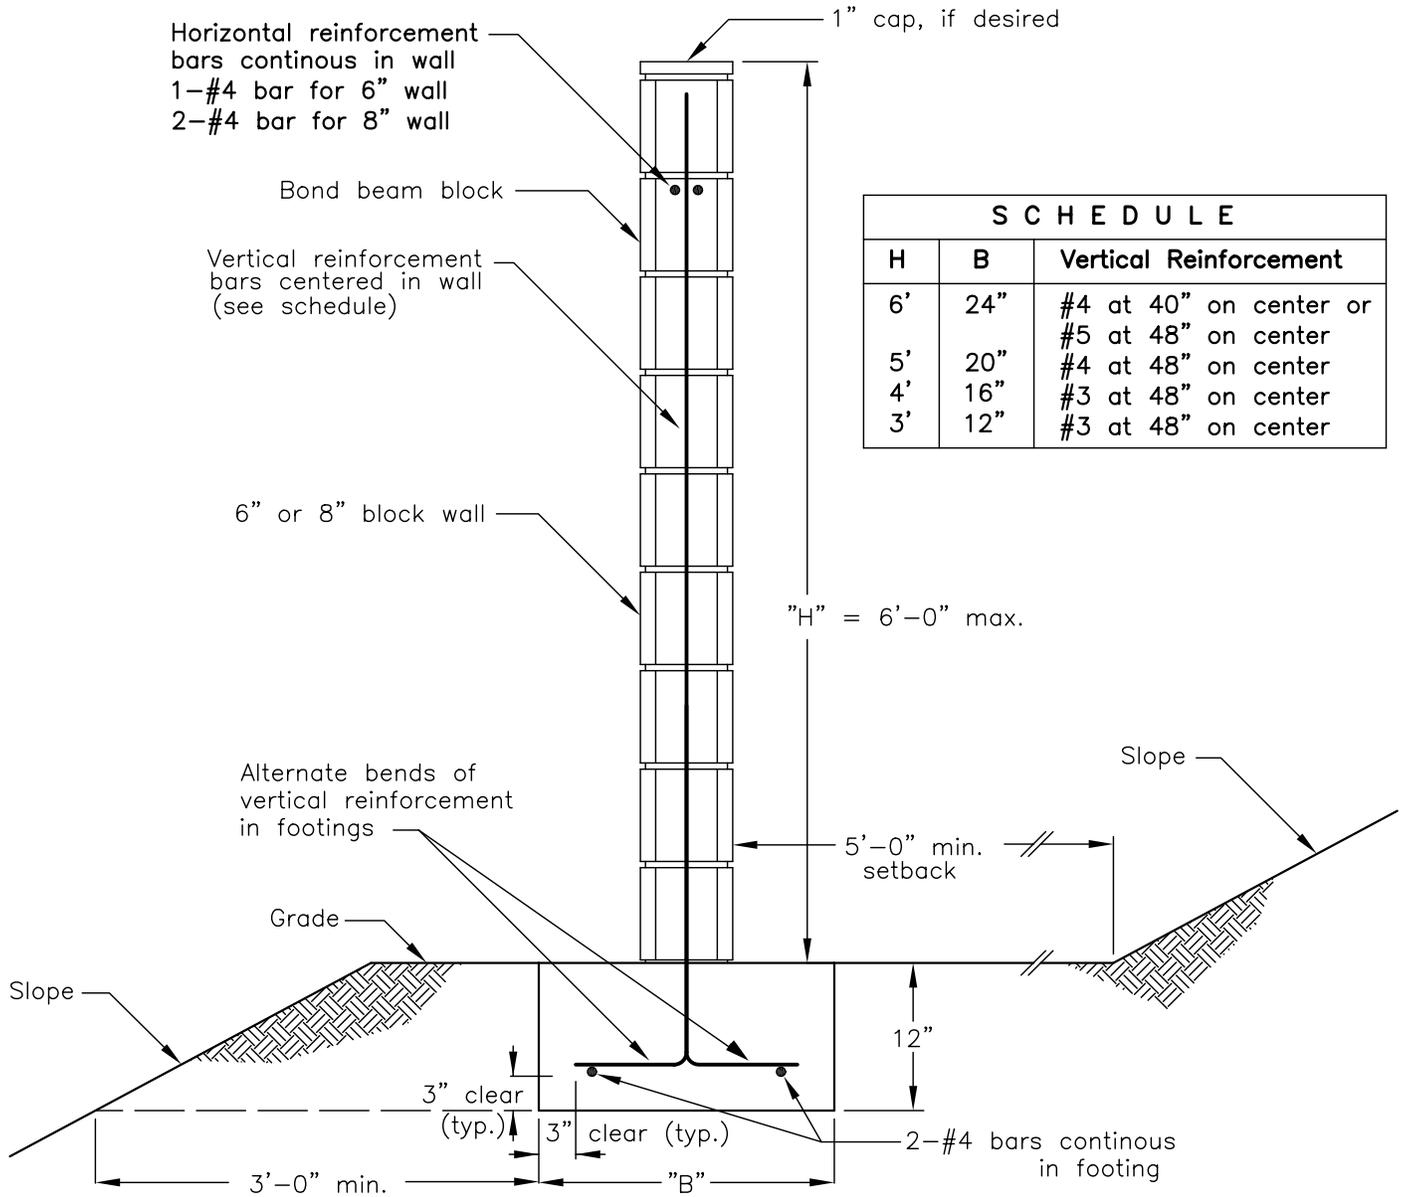

CITY OF THOUSAND OAKS
 COMMUNITY DEVELOPMENT DEPARTMENT
 BUILDING DIVISION

Prepared by: Dragos Teodorescu P.E.

Approved by: Dave Hueners P.E.

Building Official

CONCRETE BLOCK GARDEN WALL

Sheet 1 of 1

January 2008

B-3