
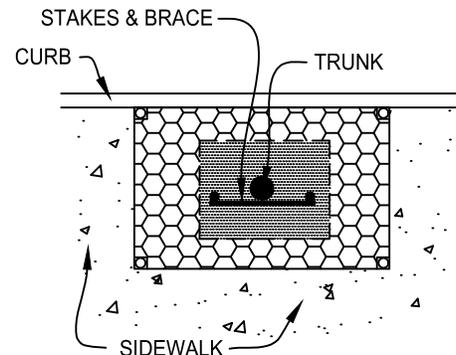


PLANTING AND STAKING

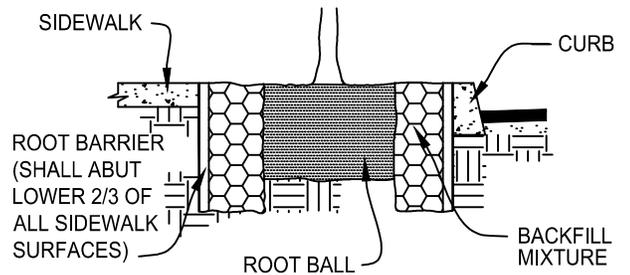

TREE WELL

DETAILS AND SECTIONS

NOT TO SCALE

NOTES:

1. SPECIES SHALL BE APPROVED BY THE CITY'S FORESTRY MASTER PLAN.
2. ALL TREES SHALL BE OF GOOD HEALTH WITH A SOUND ROOT SYSTEM AND STRAIGHT, SINGLE TRUNK.
3. MINIMUM TREE SIZE SHALL BE 24" BOX SIZE CONTAINER, WITH A 3/4" TRUNK CALIPER AND 6' HEIGHT. WHERE TREES ARE LOCATED WITHIN SIGHT DISTANCE AREAS PER PLATE 3-10, MINIMUM CANOPY CLEARANCE SHALL BE 8'.
4. CONTACT CITY LANDSCAPE INSPECTOR AT 805-449-2499, FOR APPROVAL OF LOCATIONS, QUALITY OF PLANT MATERIAL AND INSTALLATION.
5. SURFACE SIZE OF TREE WELL ARE TO BE 4' X 8' UNLESS AMERICAN DISABILITIES ACT (ADA) REQUIREMENTS NECESSITATE A SMALLER OPENING.
6. EXCAVATE PLANTING PIT WIDTH TWICE THE SIZE OF THE ROOT BALL, OR EQUAL TO WELL, WHICH EVER IS LARGER.
7. INSTALL 1-1/2' X 6' ROOT BARRIER PANEL (S) ADJACENT TO PAVING WHEREVER TREE IS 6' OR CLOSER TO HARDSCAPE (SIDEWALK, CURB, WALL, ETC.).
8. AMENDED BACKFILL SHALL EQUAL 2/3 EXCAVATED SOIL AND 1/3 "APPROVED" SOIL AMENDMENT. BACKFILL ENTIRE PLANT PIT/TREE WELL WITH AMENDED SOIL. THOROUGHLY TAMP BACKFILL TO ELIMINATE AIR POCKETS.
9. TREES IN LAWN OR RESIDENTIAL FRONT YARDS SHALL HAVE A TRUNK PROTECTOR INSTALLED AT GROUND LEVEL, TO PREVENT DAMAGE TO BARK AND CAMBIUM.
10. ALL TREES SHALL BE PLANTED WITHIN THE CITY RIGHT-OF-WAY OR PUBLIC SERVICE EASEMENT.
11. SEE PLATE NOS. 1-8 AND 1-9 FOR ADDITIONAL STREET TREE PLANTING REQUIREMENTS.
12. ROOT BALL SHOULD BE FREE OF GIRDLING ROOTS.

CHANGE	DESCRIPTION	DATE	INITIAL

APPROVED:  
 CITY ENGINEER DATE