


# CITY OF THOUSAND OAKS SLOPE SETBACK REQUIREMENTS FOR POOLS

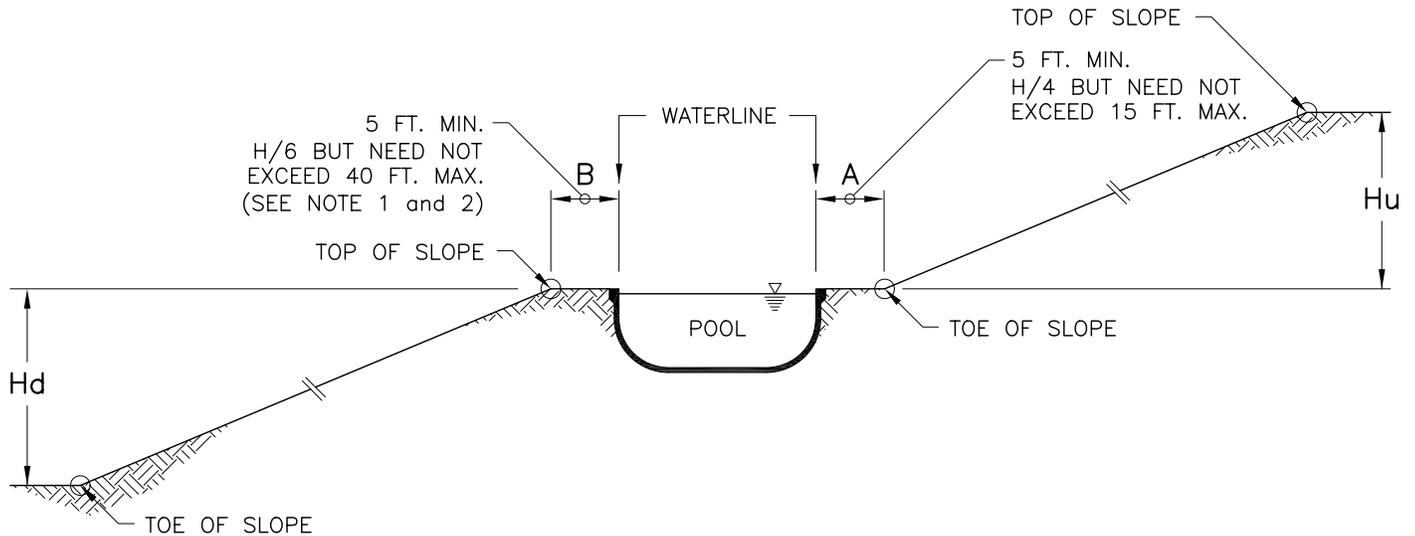

**NOTE 1:**

**Downslope Setback**

If dimension B is less than 7 feet, then the pool wall adjacent to the downslope shall be capable of supporting water in the pool without soil support (freestanding wall design) and shall be capable of supporting soil pressure with pool empty.

Hd = HEIGHT OF DOWNSLOPE – vertical dimension from top of slope (pool deck elevation) to toe of slope.

Hu = HEIGHT OF UPSLOPE – vertical dimension from toe of slope (pool deck elevation) to top of slope.

A = UPSLOPE SETBACK DIMENSION – horizontal dimension from the waterline to toe of slope.

B = DOWNSLOPE SETBACK DIMENSION – horizontal dimension from the waterline to top of slope.

DOWNSLOPE SETBACK DIMENSION	
H	B
0' – 30'	5'
30' – 240'	H/6
More than 240'	40'

UPSLOPE SETBACK DIMENSION	
H	A
0' – 20'	5'
20' – 60'	H/4
More than 60'	15'



**CITY OF THOUSAND OAKS**  
COMMUNITY DEVELOPMENT DEPARTMENT  
BUILDING DIVISION

Prepared by: Dragos Teodorescu P.E.

**SLOPE SETBACK REQUIREMENTS  
FOR POOLS**