
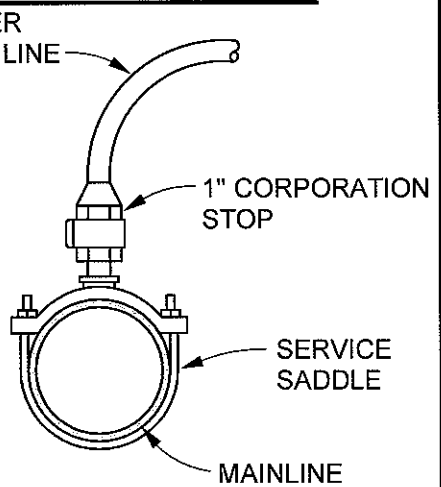


**2" COMBINATION AIR RELEASE AND VACUUM VALVE ASSEMBLY**

**1" COMBINATION AIR RELEASE AND VACUUM VALVE ASSEMBLY**

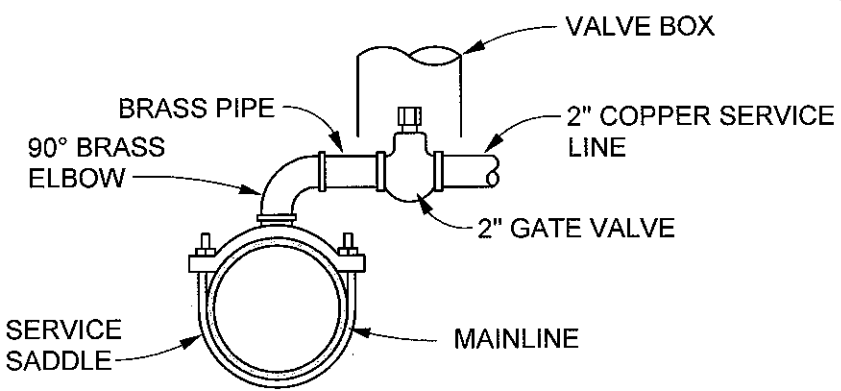

**CONNECTION AT HIGH POINT ON WATER MAIN**

**NOTES:**

1. SERVICE LINE TO BE INSTALLED AS SHOWN ON PLATES 36-2 AND 36-4.
2. ASSEMBLIES IN UN-PROTECTED AREAS REQUIRE GUARD POSTS.
3. 2" ASSEMBLY REQUIRED FOR END OF MAIN LOCATIONS AND SHALL BE AT THE LOCATION AS SHOWN ON PLATE 33-2.

CHG	DESCRIPTION	DATE	INITIAL
APPROVED	<i>Jay D. Morgan</i> CITY ENGINEER	6.10.09 DATE	

**CITY OF THOUSAND OAKS**  
PUBLIC WORKS DEPARTMENT

**COMBINATION AIR RELEASE & VACUUM VALVE INSTALLATION**

PLATE NO.  
**33-4**